


NOTES:

1. SPRINKLER MAINS AND BRANCHES SHALL TAKE PRECEDANCE OVER HEATING PIPING, DRAINAGE PIPING, AND DUCTWORK WHERE CONFLICTS OCCUR, DUE TO CRITICAL SLOPE REQUIRED FOR SPRINKLER SYSTEM.
2. SUSPENDED CLG. HEIGHT IS 15'-0" EXCEPT BETWEEN GRIDS W AND X (NORTH OF 13) WHICH IS @ 17'-0".

IMR / AD/OPS

KEY PLAN

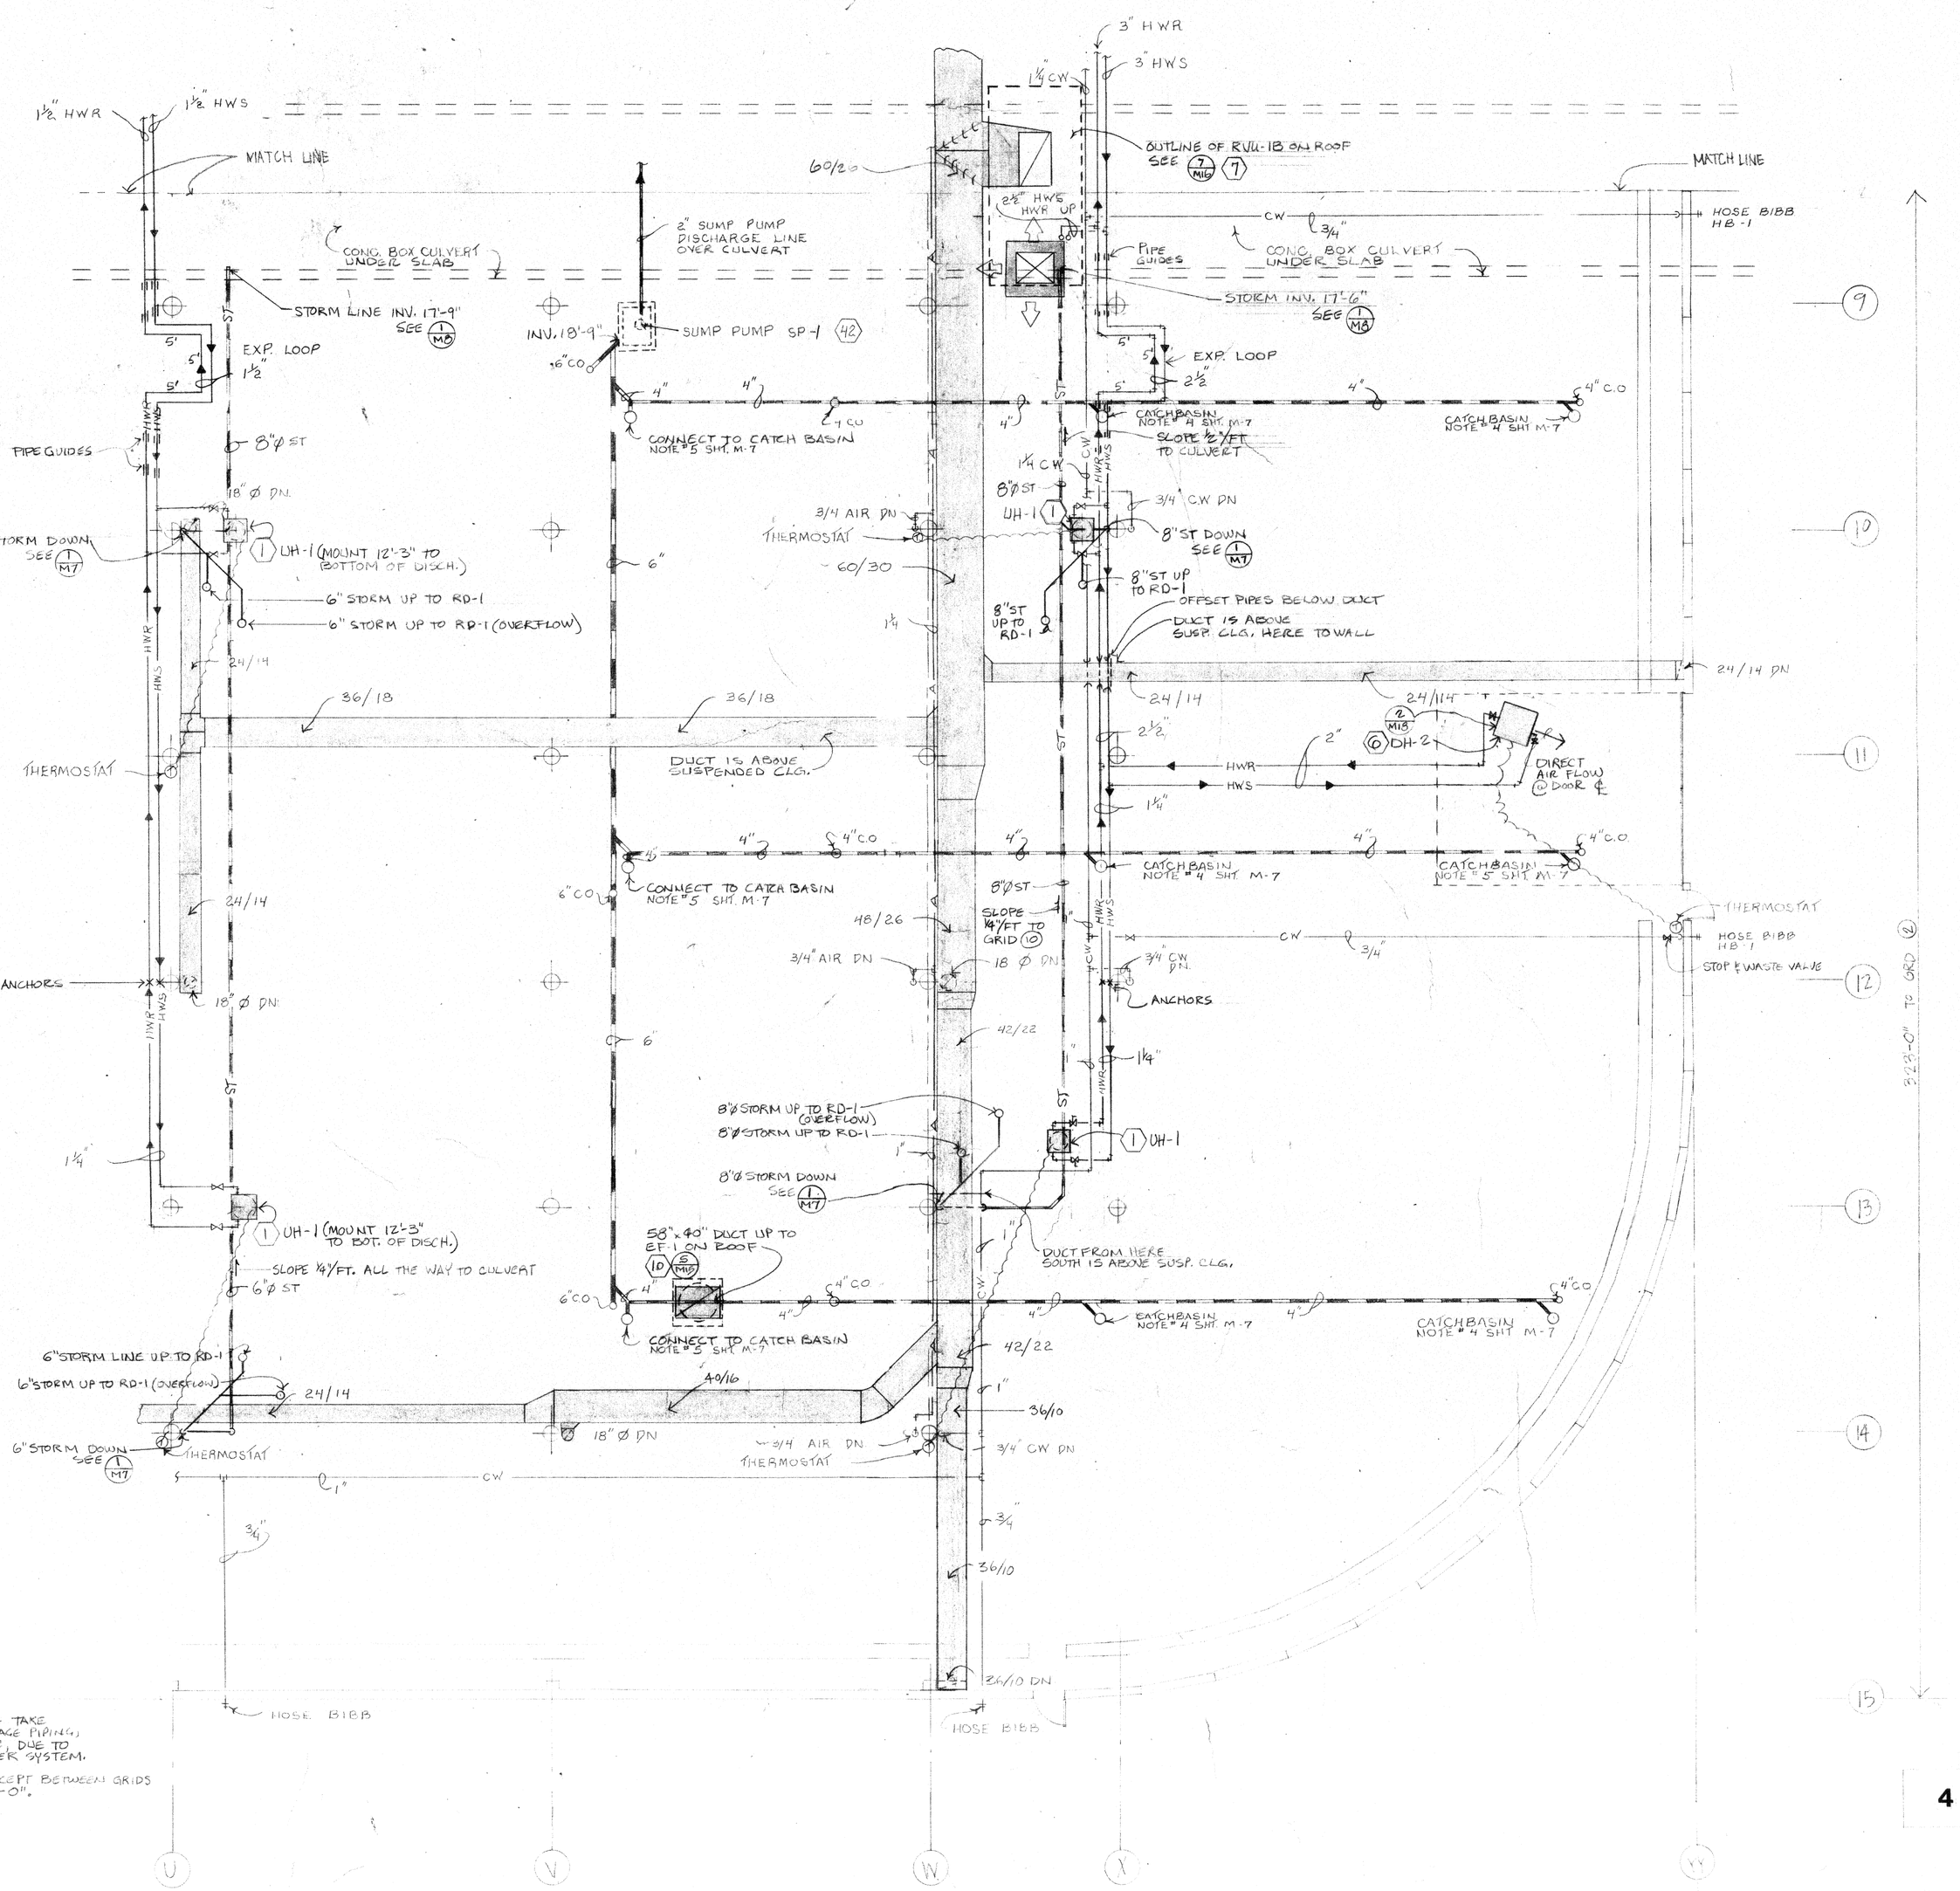

Thomas and Vecchi A.I.A. Architects

I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Registered Architect under the laws of the State of MINNESOTA.

Date 2-21-80 Reg. No. 10041

**DTA OPERATING CENTER**
**PHASE 3 CONSTRUCTION**
**PROJECT NO. MN-03-0018**
**DULUTH MINNESOTA**

**MECHANICAL INSTALLATION**

**BUS STORAGE - SE SECTION, PLUMBING, HEATING, VENTILATION**

John Ivey/Thomas A Vecchi, Inc. 1518 East Superior Street, Duluth, Minnesota 55812 (218) 724-8802

Job No. 7810 | Date:
Drawn By: JI | Drawer:
Sheet: M-10 of