NOTES

1. SPRINKLER MAINS & BRANCHES SHALL TAKE PRECEDENCE OVER HEATING PIPING AND DUCTWORK WHERE CONFLICTS OCCUR DUE TO CRITICAL SLOPE REQUIRED FOR THE SPRINKLER PIPINGS.

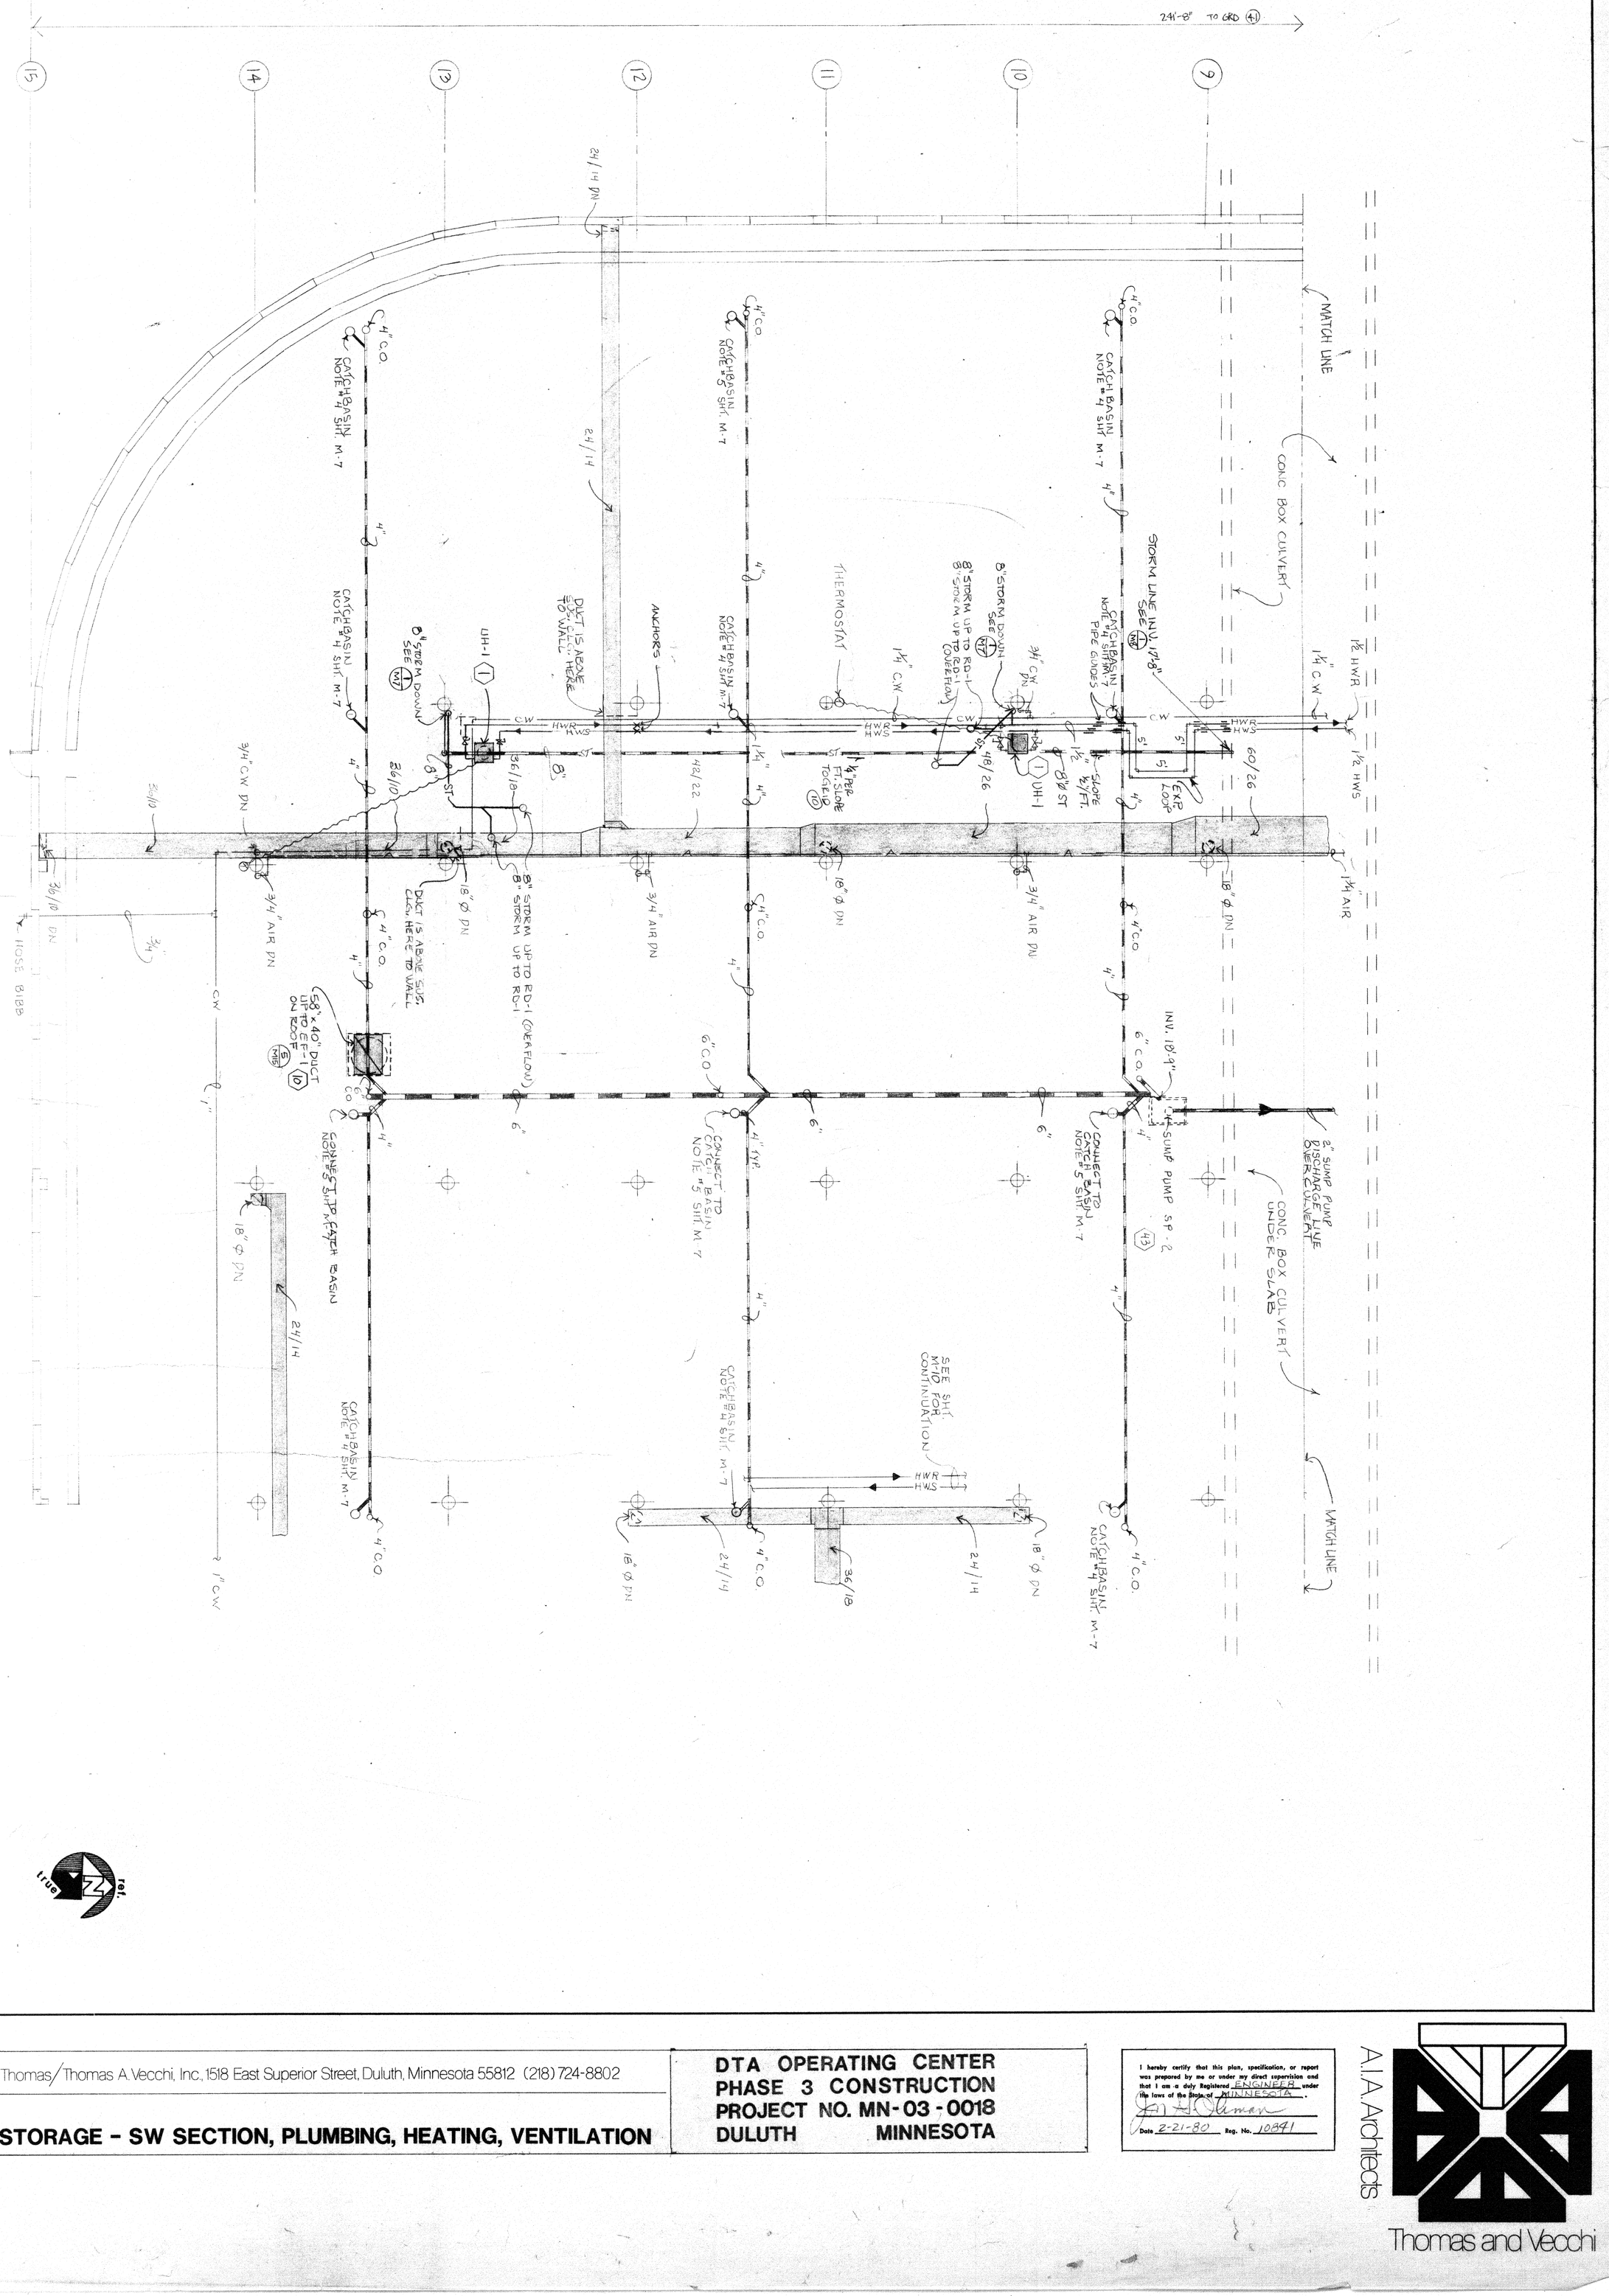

John Ivey Thomas/Thomas A. Vecchi, Inc., 1518 East Superior Street, Duluth, Minnesota 55812 (218) 724-8802

BUS STORAGE - SW SECTION, PLUMBING, HEATING, VENTILATION

DTA OPERATING CENTER
PHASE 3 CONSTRUCTION
PROJECT NO. MN-03-0018
DULUTH MINNESOTA

I hereby certify that this plan, specification, or report was prepared by me or under my direct supervision and that I am a duly Registered ENGINEER under the laws of the State of MINNESOTA.
Date 2-21-80 Reg. No. 10891

A.I.A. Architects
Thomas and Vecchi

Job No. 7822
Drawn By:
Date:
Sheet: M-9 of